


**NOTES:**

1. CURRENT STANDARD DETAIL AT CITY ENGINEERING DIVISION SHALL PREVAIL.
2. CROWN TO BE ROUNDED WITH NO SHARP GRADE BREAKS.
3. MINIMIZE VISIBLE EXPOSED GROUT AT COBBLE JOINTS.
4. SURFACE OF COBBLE FIELD TO BE SMOOTH AND FLAT TO GRADE WITHOUT VARIATION IN HEIGHT OF INDIVIDUAL COBBLES.
5. COBBLES WITH BREAKS OR FRACTURES ARE NOT ALLOWED.
6. ROCK SHALL BE 'SATURATED SURFACE MOIST' (SSM) PRIOR TO PLACEMENT.
7. CONCRETE BED SHALL HAVE A CEMENT RATIO PER CUBIC YARD OF CONCRETE OF NOT LESS THAN 564 POUNDS; SLUMP MAX. OF 3"; AGGREGATE SIZE 1/4" MAXIMUM.
8. INTEGRAL COLOR ADMIXTURE: COLOR 641-YOSEMITE BROWN, BY DAVIS COLOR, C-21 CHROMIX G & L ADMIXTURE, BY SCOFIELD, OR APPROVED EQUAL. ADMIXTURE CAN BE GRANULAR (G), LIQUID (L), OR POWDERED (P).

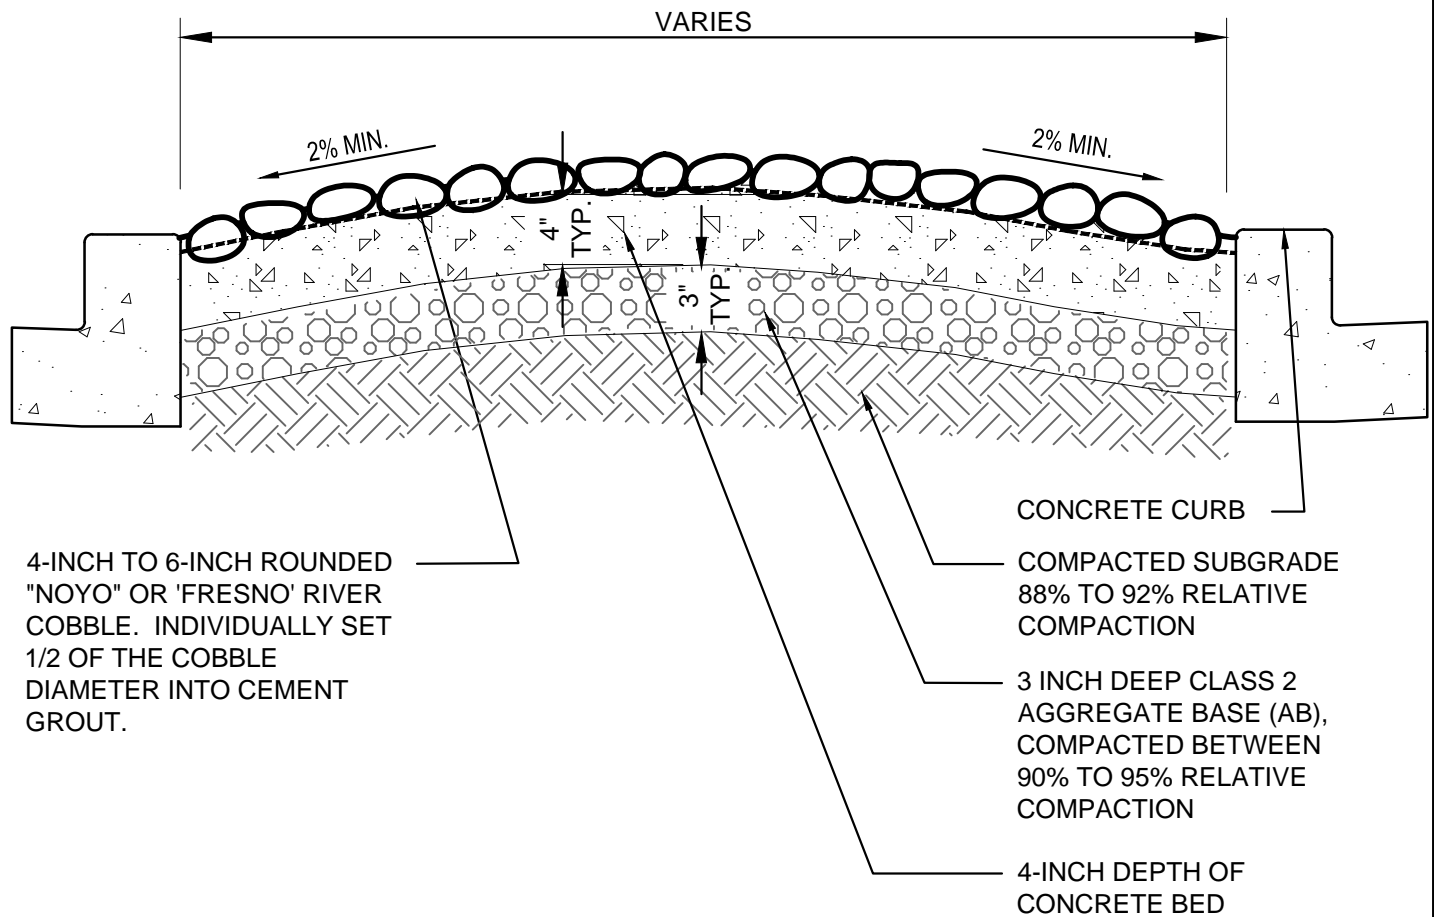

4-INCH TO 6-INCH ROUNDED "NOYO" OR 'FRESNO' RIVER COBBLE. INDIVIDUALLY SET 1/2 OF THE COBBLE DIAMETER INTO CEMENT GROUT.

CONCRETE CURB  
 COMPACTED SUBGRADE  
 88% TO 92% RELATIVE COMPACTION  
 3 INCH DEEP CLASS 2 AGGREGATE BASE (AB), COMPACTED BETWEEN 90% TO 95% RELATIVE COMPACTION  
 4-INCH DEPTH OF CONCRETE BED

			<h2 style="margin: 0;">CITY OF FREMONT</h2> <h3 style="margin: 0;">STANDARD DETAILS</h3> <h3 style="margin: 0;">CITY STANDARD</h3> <h3 style="margin: 0;">MEDIAN PAVING COBBLE</h3>			DATE APPROVED BY CITY COUNCIL 12/13/11													
						RESOLUTION NO. 2006-31													
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 33%;"></td> <td style="width: 33%;">General Revision</td> <td style="width: 33%;">07/31/22</td> </tr> <tr> <td></td> <td>General Revision</td> <td>08/2019</td> </tr> <tr> <td>APPR</td> <td>REVISED</td> <td>DATE</td> </tr> <tr> <td colspan="3" style="text-align: center;">REVISIONS</td> </tr> </table>				General Revision	07/31/22		General Revision	08/2019	APPR	REVISED	DATE	REVISIONS			CITY ENGINEER				
				General Revision	07/31/22														
	General Revision	08/2019																	
APPR	REVISED	DATE																	
REVISIONS																			
FILE NO. LSD-7.DWG	SCALE 1" = 1'-0"	DRAWN PM/MM	CHECKED RER	DATE 10/07/2005	DWG NO. LSD-7	1 of 1													